


NOTES:

1. SEPARATION DISTANCES FROM WATER SUPPLIES AND PIPE CLASSIFICATIONS SHALL CONFORM TO INDIANA STATE BOARD OF HEALTH'S "ON-SITE WATER SUPPLY AND WASTEWATER DISPOSAL FOR PUBLIC AND COMMERCIAL ESTABLISHMENTS - BULLETIN S.E. 13"
2. WATER MAINS SHALL BE LOCATED ON AN UNDISTURBED LEDGE.

IF "A" IS	IF "B" IS	THEN SANITARY SEWER PIPE SEGMENT SHALL BE
18" OR MORE	10' OR MORE	NO SPECIAL PIPE MATERIAL OR GRADE REQUIREMENTS
LESS THAN 18"	LESS THAN 10'	PVC (EITHER ASTM D2241 (SDR 21) ANSI/AWWA C900 (DR 18) ANSI/AWWA C905 (DR 21) DUCTILE IRON (CLASS 51 MIN.)

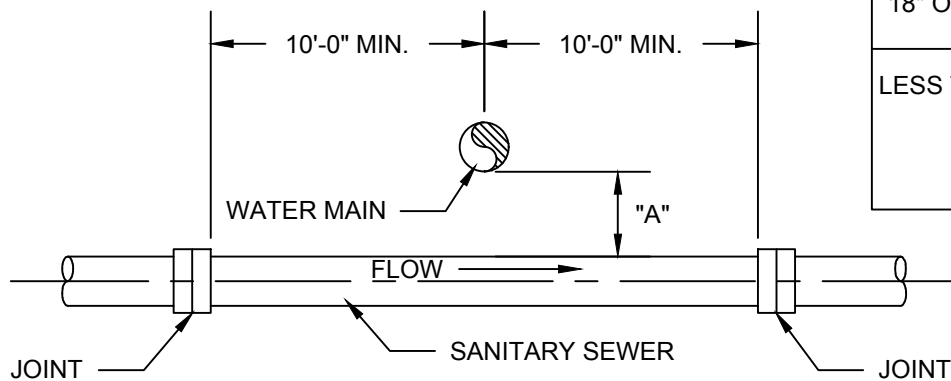

City of Carmel Utilities Standard Details		Title: WATER LINE CROSSING DETAIL	
Date: January 2016	Scale: Not To Scale	Drawing: CS 32	Page 35