

NOTE:

- 1) 1" Or Smaller Service Line Shall Be Direct Tap Unless Approved By Carmel Utilities.
- 2) Corporation Stop Shall Be Brand And Model Approved By Carmel Utilities.

3) Service Line Tap Shall Be Installed With A Min. Horiz. Separation of 24".

4) 2 Inch Taps And Smaller Shall Not Be Installed Within 18 Inches of Mechanical Joints And Bells.


5) No Meter Pits Allowed in Areas Sidewalks, Driveways, Roads, Etc.

6) Granular Backfill Required Around All Meter Pits With 6" Topsoil

7) Short Side Services Require Type K-Copper
 Long Side Services Require Poly SDR9 With Tracer Wire
 (Only with Carmel Utilities Approval)

8) No Service Tap shall be under Any Part of the Drive Way.
 Taps under Drive Ways Shall be Abandoned and Re-Tapped Away from Driveway. Abandoned Tap will be Removed and Repair Clamp Placed.

Tapped Full-Circle Wrap Around Stainless Steel Service Clamp

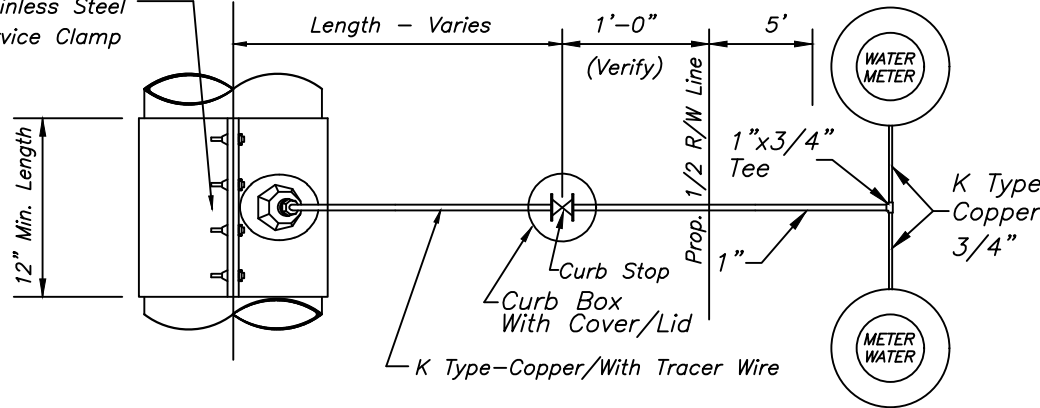

* Service Clamp Must Be Omitted For Services 1" And Smaller And Direct Taps Made to Ductile Iron Pipe, Class 350 Or Greater. (Verify With Owner For Pressure Class DIP.) All PVC Pipe Requires a Tapped Full Circle Wrap Around Stainless Steel Service Clamp.



3450 W. 131st. Street
 Carmel, IN 46074

Phone: 317-733-2855
 Fax: 317-733-2053

CARMEL WATER
 STANDARD DETAILS

TITLE:

DUAL METER PIT

Date: January 2023

Scale: No Scale

Drawn By: Crossroad Engineers

Drawing Name: CW-1