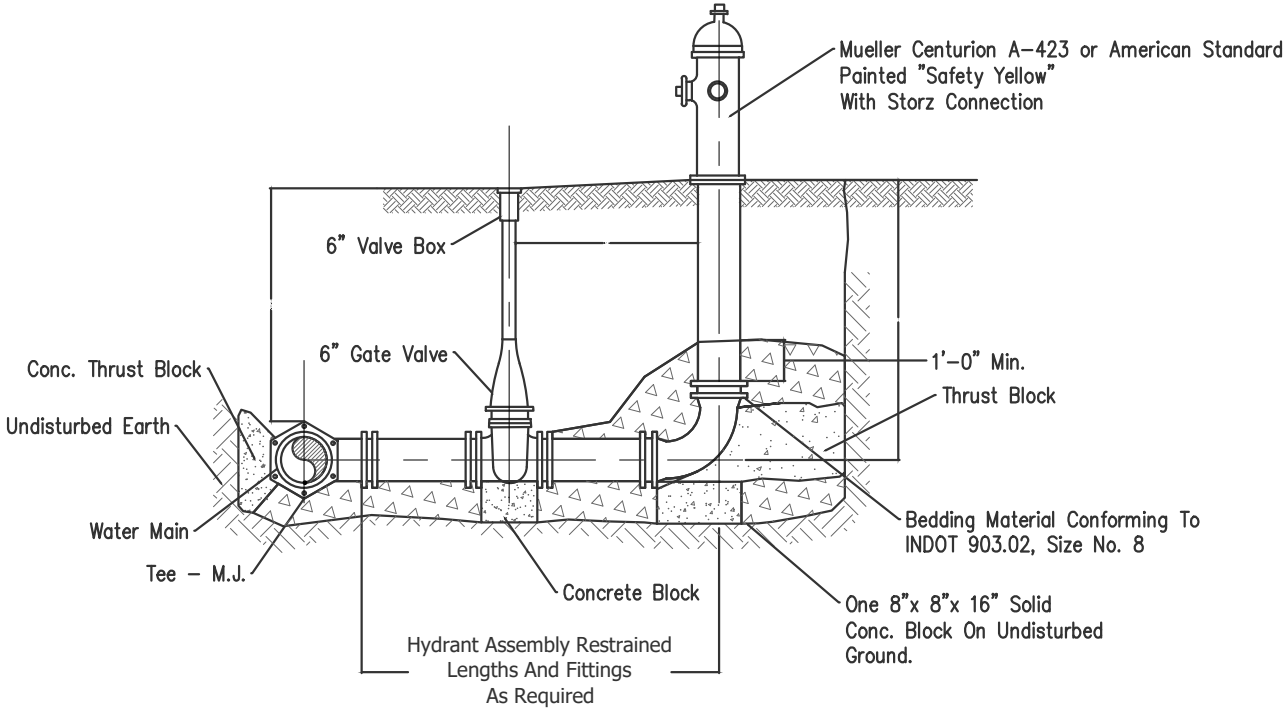

NOTES

1. All Joints Shall Be Restrained.
2. Hydrants Shall Be Set At 500' Max. Horizontal Distance, Or Less As Specified By Fire Department.
3. All Valves Must Include Posi-Cap Or Equivalent.
4. Private Hydrants To Be Painted Red From Factory
5. Hydrant Valves Must Be Restrained To The Tee
6. All Hydrant Stubs Must Have Tracer Wire.

City of Carmel Utilities
3450 W. 131st. Street
Carmel, IN 46074
Phone: 317-733-2855
Fax: 317-733-2053

CARMEL WATER STANDARD DETAILS

TITLE: FIRE HYDRANT ASSEMBLY

Date:	Scale:	Drawn By:	Drawing Name:
January 2023	No Scale	Crossroad Engineers	CW-32